




TYPICAL TEMPORARY SERVICE

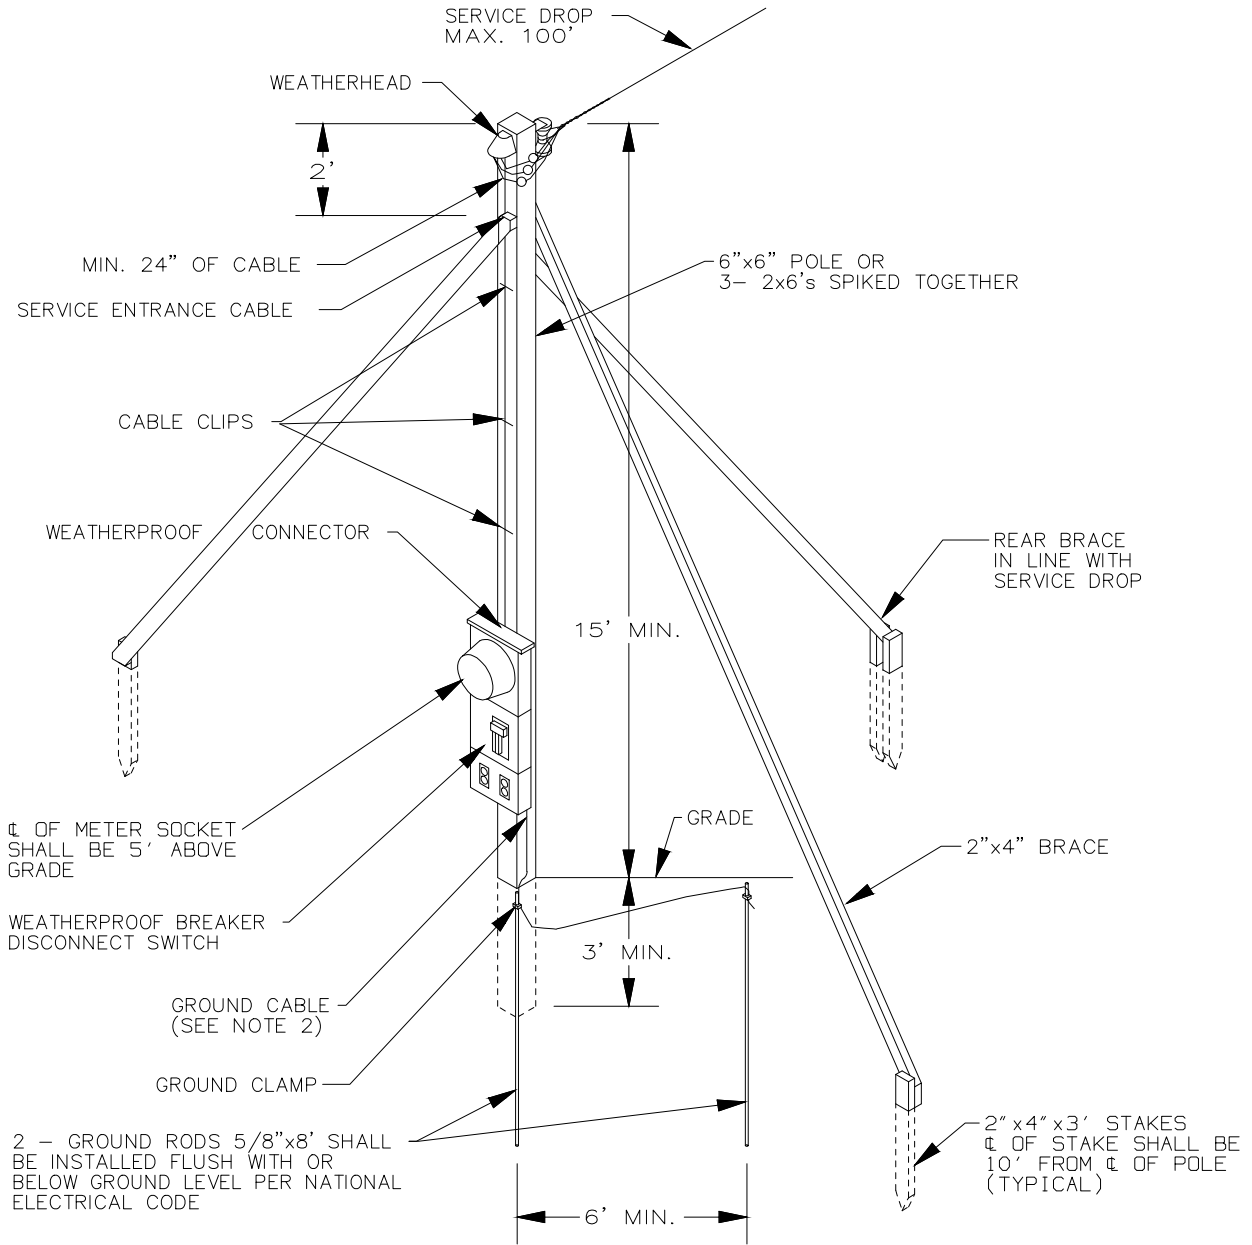

NOTES:

1. A minimum of 18' clearance is required above all roads, streets, nonresidential driveways, parking lots and other land traversed by vehicles.
2. A minimum #6 copper ground cable must be connected in the meter socket, to its own ground terminal. The grounding electrode conductor shall be adequately protected.
3. Temporary service is limited to a six month time period unless extension is approved by VEC.
4. Rain tight service equipment, with ground fault protection and provision for locking, and all other materials and equipment to be owned and installed by customer. VEC to install meter and service drop and connect service drop at weatherhead.
5. Service location and type of construction must be approved in advance by VEC.
6. Where subject to state or local electrical inspection, such inspection must be made prior to energizing.

							VERMONT ELECTRIC COOPERATIVE INC. JOHNSON, VT
							TYPICAL TEMPORARY SERVICE
						DES: DRN: CB CKD: SCALE: NONE DATE: 07/10/2017	DWG. NO. 301 Page 1
REV	DATE	REVISION DESCRIPTION	DRN	CKD			REV 1