

STANDARD OVERHEAD CONDUCTORS

SCOPE:

This standard applies to all new construction and all reconstruction which is necessary due to planned system upgrades, road improvement projects, or other unavoidable circumstances

Existing circuits and lines operating above the load levels shown here do not come under this standard if there are no other requirements for reconstruction.

The graph below provides a means to determine the economic conductor size to install at a present annual peak load.


Where spacer cable is to be installed the size should be selected to match the equivalent bare conductor size.

BARE:


<u>Description</u>	<u>Trade Name</u>	<u>Inventory Number</u>
1/0 AAAC 6/1	Azusa	L1233
336 MCM ACSR 26/7	Linnet	L1229
556 MCM ACSR 26/7	Dove	L1251

COVERED:

<u>Description</u>	<u>Trade Name</u>	<u>Inventory Number</u>	<u>Hendrix Number</u>
1/0 AAAC 6/1	Azusa	L1268	T0010RY15B3-00
336 MCM ACSR 26/7	Linnet	L1236	T0336RR15B3-01

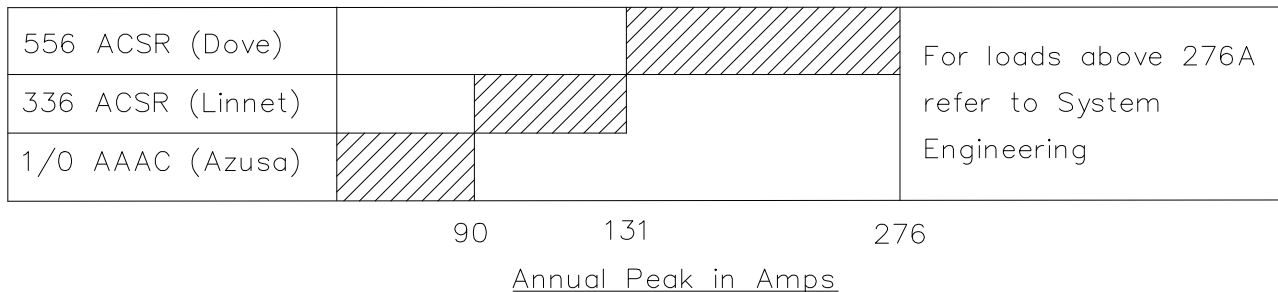

Covered conductors shall be used when necessary to provide additional protection from occasional tree contact. Use of covered wire is not an alternative to adequate tree trimming

							Vermont Electric Cooperative Inc.
							Johnson, VT
							STANDARD OVERHEAD CONDUCTOR
						DPS: MC ENG: CB PRC: SJ SCALE: NONE DATE: 06/26/2018	DWG. NO. 101 Page 1
REV	DATE	REVISION DESCRIPTION	DRN	CKD			REV 